





(LEFT ADVANCE SKEW SHOWN)
(RIGHT ADVANCE SKEW OPPOSITE HAND)



DESIGN UNIT STRESSES:
CLASS B-1 CONCRETE, $f'_c = 4,000$ psi
REINFORCING STEEL (GRADE 60), $f_y = 60,000$ psi

ALL DIMENSIONS SHOWN ARE IN INCH UNLESS OTHERWISE NOTED.

FOR DIMENSIONS AND SIZE AND SPACING OF REINFORCING STEEL, SEE
STANDARD SHEET 703.85.

LAP ALL LONGITUDINAL BARS A MINIMUM OF 23" AT SPLICES.

MINIMUM CLEARANCE TO REINFORCING STEEL SHALL BE 1-1/2" UNLESS OTHERWISE SHOWN.

PREFORMED FIBER EXPANSION JOINT MATERIAL SHALL BE SECURELY STITCHED TO ONE FACE OF THE CONCRETE WITH NO. 10 GAGE COPPER WIRE OR NO. 12 GAGE SOFT DRAWN GALVANIZED STEEL WIRE.

D, BEVELED HEADWALL TO BE LOCATED AT UPSTREAM END.

A FILTER CLOTH 3 FEET IN WIDTH AND DOUBLE THICKNESS SHALL BE APPLIED TO ALL TRANSVERSE JOINTS IN THE TOP SLAB AND SIDEWALLS. THE MATERIAL SHALL BE CENTERED ON THE JOINT AND THE EDGES SEALED WITH A MASTIC OR WITH TWO SIDED TAPE. THE FILTER CLOTH SHALL BE A GEOTEXTILE MEETING SEC 1011 FOR SUBSURFACE DRAINAGE. COST OF FURNISHING AND INSTALLING THE FILTER CLOTH WILL BE CONSIDERED COMPLETELY COVERED BY THE CONTRACT UNIT PRICE FOR OTHER ITEMS.

FOR MORE DETAILS AND SECTION THROUGH BOX, SEE 703.83
SHEET 2 OF 2.

- ① UPSTREAM = 3'-5"
DOWNSTREAM = 4'-0"
- ② IF MORE THAN ONE TRANSVERSE JOINT IS REQUIRED, SEE STANDARD SHEET 703.82 FOR DETAILS.
- ③ NUMBER OF H2 BARS VARIES WITH SKEW.
- ④ D2 BAR LENGTH EACH SIDE OF C WALLS = 48 BAR DIAMETERS OR $\frac{1}{4}$ (CLEAR SPAN / COS SKEW ANGLE) (USE GREATER).
- ⑤ FOR DETAILS AND REINFORCEMENT IN WINGS, SEE STANDARD SHEET 703.37.
- ⑥ USE THESE BARS FOR DESIGN FILLS OF MORE THAN 2'-0".
- ⑦ USE THESE BARS FOR DESIGN FILLS OF 2'-0" OR LESS.

(*) #8 (10'-0" < $\frac{\text{CLEAR SPAN}}{\cos(\text{SKEW ANGLE})}$ ≤ 13'-0")
 #9 (13'-0" < $\frac{\text{CLEAR SPAN}}{\cos(\text{SKEW ANGLE})}$)
 OTHERWISE D2 BAR SHALL NOT BE USED.

(**) VARIES - 12" MAXIMUM


(***) USE TRANSVERSE JOINT WHEN BARREL IS OVER 80 FEET LONG
BETWEEN HEADWALLS MEASURED ALONG C/L OF BOX.

USE ADDITIONAL TRANSVERSE JOINTS TO PROVIDE 50 FEET
MAXIMUM SPACING BETWEEN JOINTS.


DISTANCE BETWEEN INSIDE FACE OF HEADWALL AND
TRANSVERSE JOINT SHALL NOT BE LESS THAN 3'-0".

(****) J4 BAR SPACING


CONCRETE
TRIPLE BOX STRUCTURE
STRAIGHT WINGS
(SKEWED)

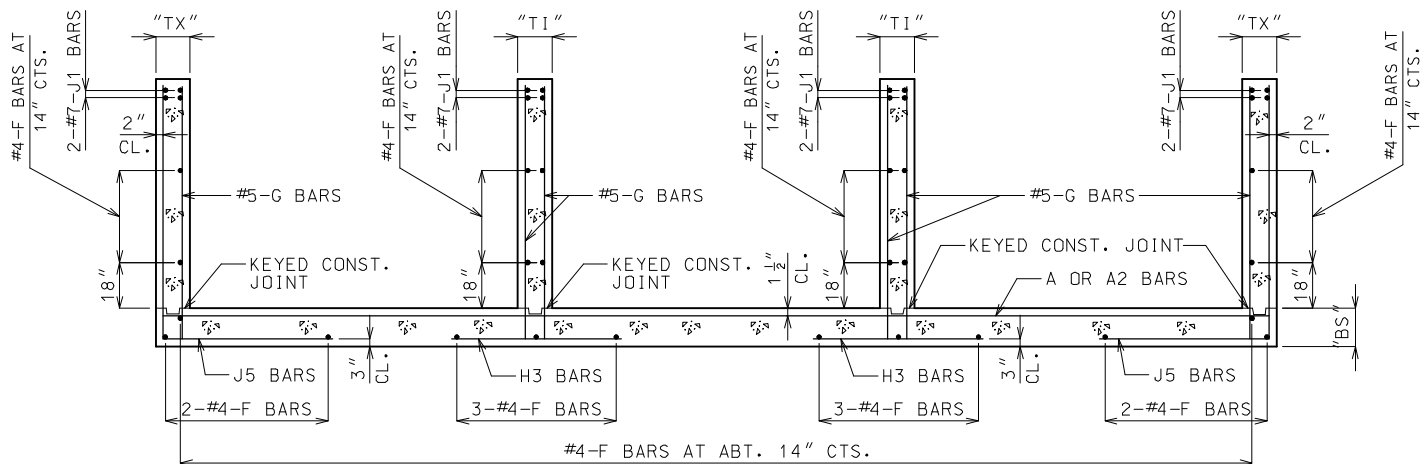


SECTION THRU WINGS (UPSTREAM SHOWN)

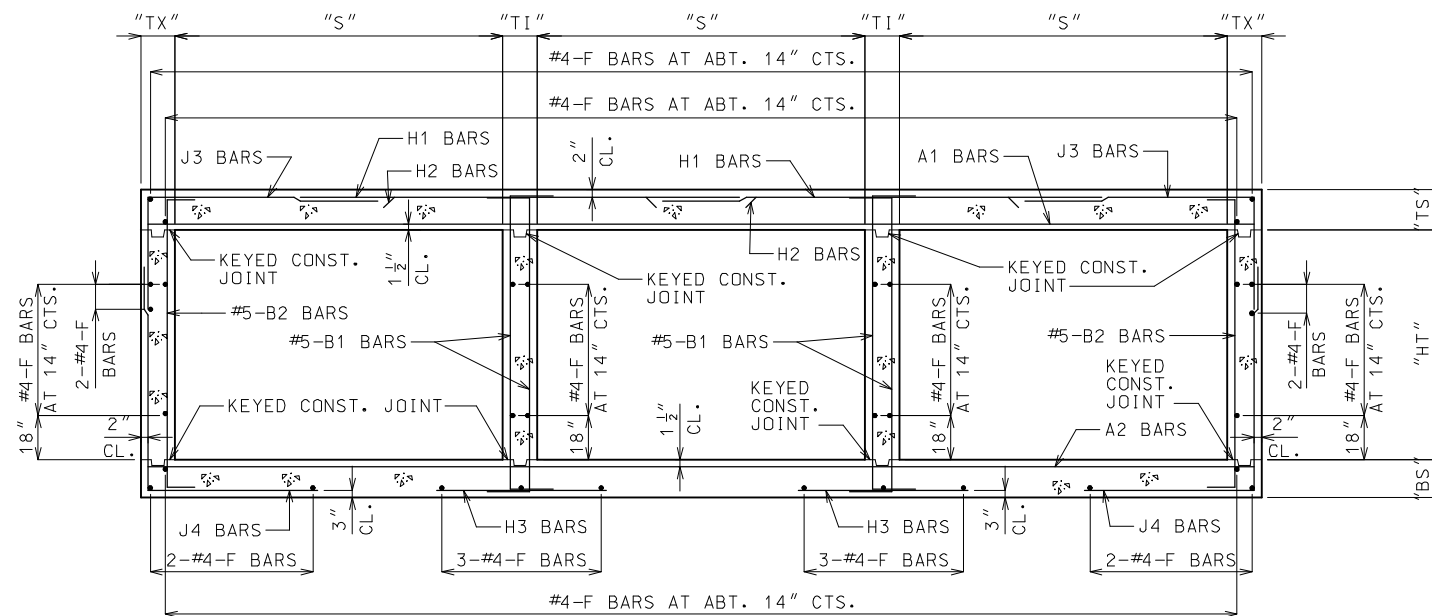


SECTION THRU BOX (DESIGN FILLS 2'-0" OR LESS)

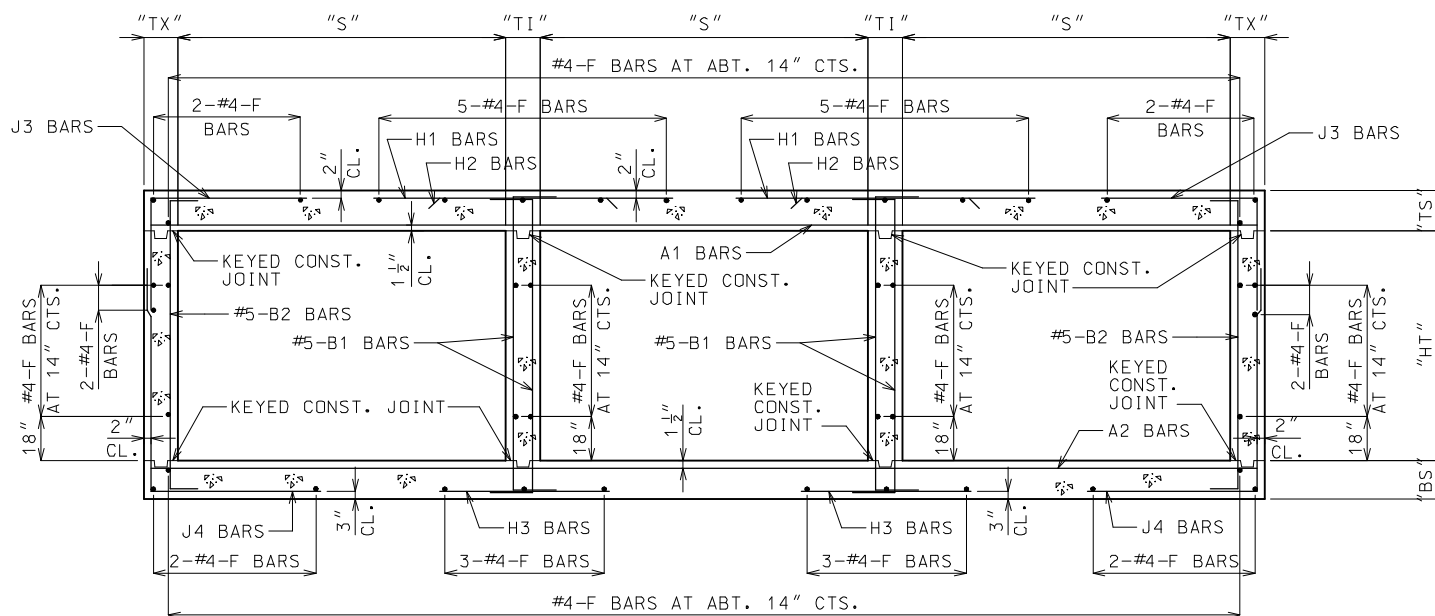

SECTION THRU BOX (DESIGN FILLS OVER 2'-0")

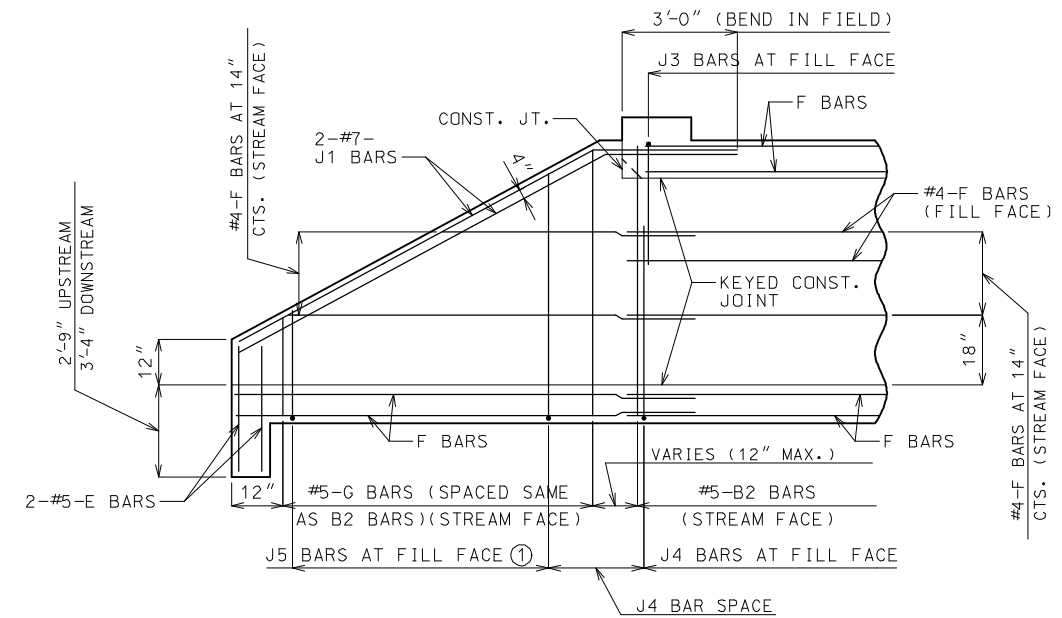

ELEVATION OF EXTERIOR WING (UPSTREAM SHOWN)

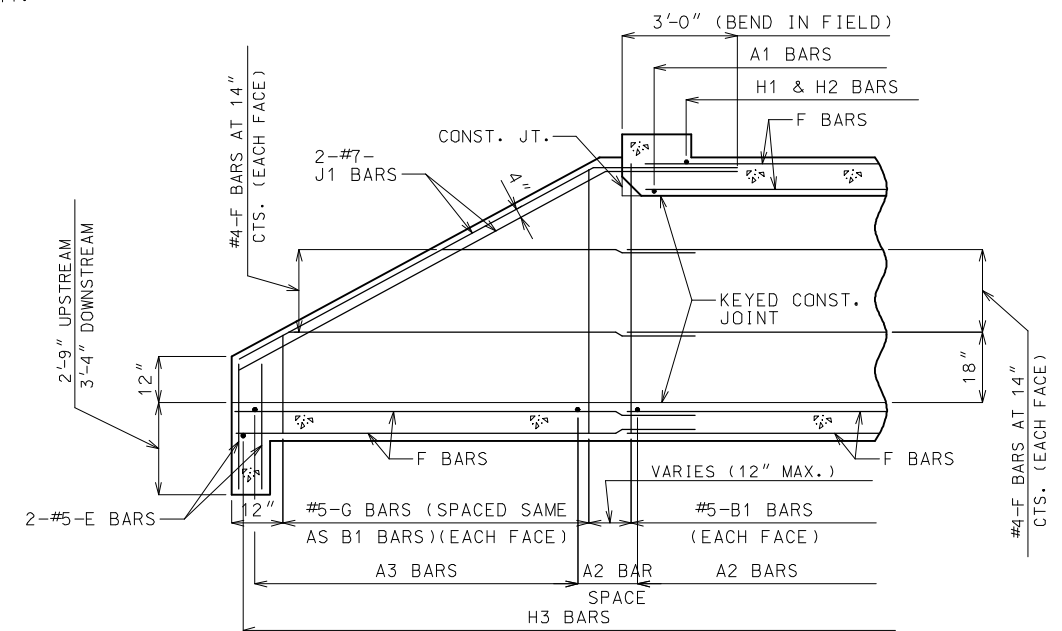

SECTION NEAR INTERIOR WING (UPSTREAM SHOWN)

GENERAL NOTES:

ALL DIMENSIONS SHOWN ARE IN INCH UNLESS OTHERWISE NOTED.

J1 BARS MAY BE BENT IN FIELD OR SHOP.

MINIMUM CLEARANCE TO REINFORCING STEEL SHALL BE 1-1/2" UNLESS OTHERWISE SHOWN.

FOR DIMENSIONS AND SIZE AND SPACING OF REINFORCING STEEL, SEE STANDARD SHEET 703.85.

① FOR DETAILS OF REINFORCEMENT IN WINGS, SEE STANDARD SHEET 703.37.

MISSOURI HIGHWAY AND TRANSPORTATION COMMISSION			
CONCRETE TRIPLE BOX STRUCTURE STRAIGHT WINGS (SKEWED)			
DATE: _____	EFFECTIVE: 09-01-2006	703.83G	2/2